

SRC-100 Series Zone Controllers

The SRC-100 series controllers have been designed for zone heating and cooling control. The controllers have 3 analogue 0..10Vdc outputs and two digital outputs that can be configured for heating and cooling control. The controllers can operate as Proportional Only or as Proportional + Integral Controllers.

The controller can have up to 2 heating and cooling stages. The analogue outputs can be individually configured for any of the heating/cooling stages and digital outputs can be configured as 3-point, PWM (thermic) or On/Off control. The controller can also operate as heating/cooling controller where the change-over is done via the digital Input.

The controller setpoint can be adjusted $\pm 3^{\circ}\text{C}$ (default) by rotating the potentiometer. The setpoint centre and setpoint limits can be adjusted in the configuration mode or via the configuration tool.

The controller can also use an external sensor for high limit and low limit control used typically in under-floor heating.

On the models without the display; red and blue LEDs indicate the controller operation in heating or cooling mode. In the display models, the display shows the heating and cooling modes, the current active actuator position, and the current temperature




reading. When the setpoint is adjusted, the backlight is switched temporarily on and the current setpoint is displayed.

Model Type	Model	Description
	SRC-100	Zone (Room) Controller with Heating and Cooling Outputs
	SRC-100-LCD	Zone (Room) Controller with Heating and Cooling Outputs, LCD Display
	-LCD	LCD Display Option for Commissioning of SRC-100
	SW-DCT-USB	Windows Device Configuration Tool with 1.8m USB Cable
Technical Data		
Power Supply	Power supply	24Vac/dc -10%/+15% <1VA
Displays and Interfaces	LEDs (SRC-100)	LEDs Indicating the Status (Red = Heating; Blue = Cooling)
	LCD (SRC-100-LCD)	LCD Display for Showing Plant Status (Heating/Cooling Mode, Current Temperature, Setpoint, Valve Position)
	Setpoint Potentiometer	Setpoint Adjust between 18°C and 24°C (limits adjustable)
Signal Outputs	Analogue Outputs	3 x 0..10V < 5mA
	Digital Outputs	2 x 24Vac Triacs; 1A maximum; requires 24Vac Power Supply
Signal Inputs	Built-In Sensor	0..50°C (32..122°F) $\pm 0.3^{\circ}\text{C}$ @ 25°C
	Resistive Input	1 x External NTC10K3 Sensor (Auto-Detect)
	Digital Input	1 x Digital Input, Volt-Free Contact, Impedance <1KOhm
Connections	Terminal Connections	Solid and Stranded Cable; 55° Angle for Wiring Maximum Size: 0.05 to 1.5mm ² (EN ISO) / 14 to 30 AWG (UL) Rising Clamp: Size 2.5 x 1.9mm
Environmental Conditions	Operating	
	Temperature	0°C...+50°C (32..122°F)
	Humidity	0...95%rh (non-cond.)
	Storage	
	Temperature	-30°C...+70°C (-22..158°F)
	Humidity	0...95%rh (non-cond.)

Standards	CE Conformity	CE Directive 2004/108/EY EN61000-6-3: 2001 (Generic Emission) EN61000-6-1: 2001 (Generic Immunity).
	Degree of Protection	IP20
Housing	Housing Material	ABS Plastics, Self Extinguishing
	Mounting	Wall or Junction Box Mounting, RAL9010 Pure White
	Dimensions	W86 x H120 x D29mm
	Weight	180g

Wiring Connections

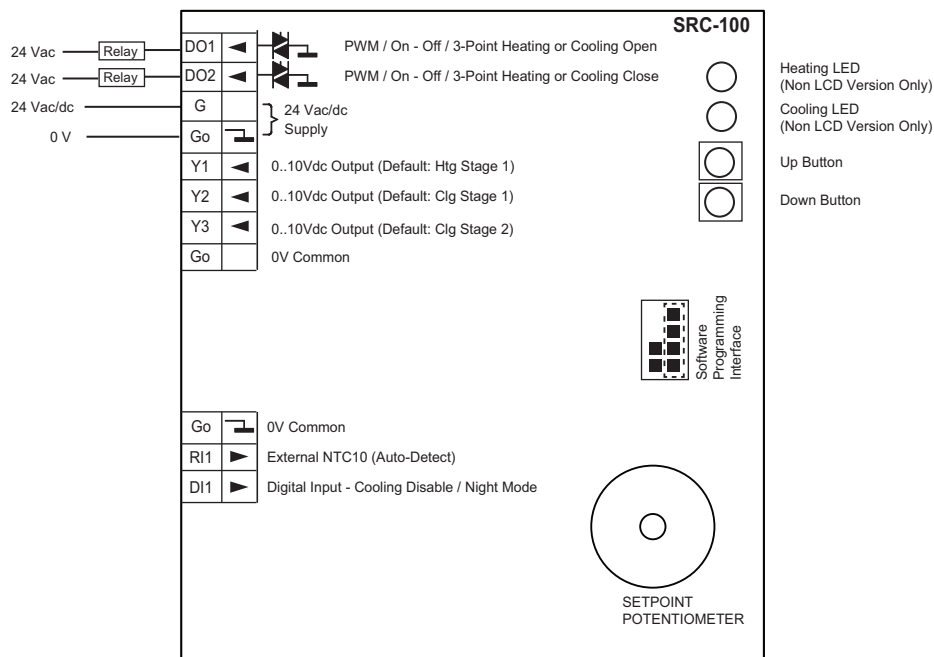


DO1	24Vac Triac; PWM, On/Off; 3-Point Open
DO2	24Vac Triac; PWM, On/Off; 3-Point Close
G	24Vac/dc Power Supply
Go	0V Common
Y1	0..10Vdc Output
Y2	0..10Vdc Output
Y3	0..10Vdc Output
Go	0V Common
Go	0V Common
RI1	External NTC10 Sensor; Main Control (Auto-detect) or High/Low Limit Sensor
DI1	Digital Input; Disable Cooling Stage / Activate Night Mode / Change-Over Heating-Cooling

Wiring Precautions

Switch off the power before any wiring is carried out.

Display (or Commissioning LCD Display): Unplug the LCD display and then wire the power supply and the analogue outputs, if relevant. After the wiring has been completed; plug-in the display and power up the device.

Setpoint Adjustment (User Mode)

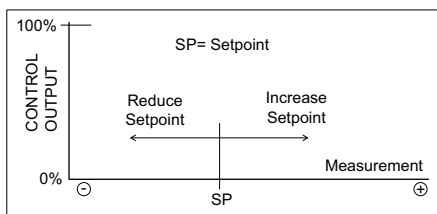


By rotating the setpoint knob option it is possible to adjust the current temperature control setpoint +/-3°C. The adjustment shifts temperature setpoint up and down. In the configuration mode or via the configuration tool it is possible to adjust the setpoint centre, and the min and max adjustments of the setpoint.

When the potentiometer is rotated the current setpoint is displayed on the screen (in display model), and the backlight is switched on momentarily.

SRC-100-LCD User Interface (User Mode)

The SRC-100-LCD controllers have a built-in LCD that can be used to show the current status of the controller. The display is also used to show number of configuration settings. The images below illustrate different display options.

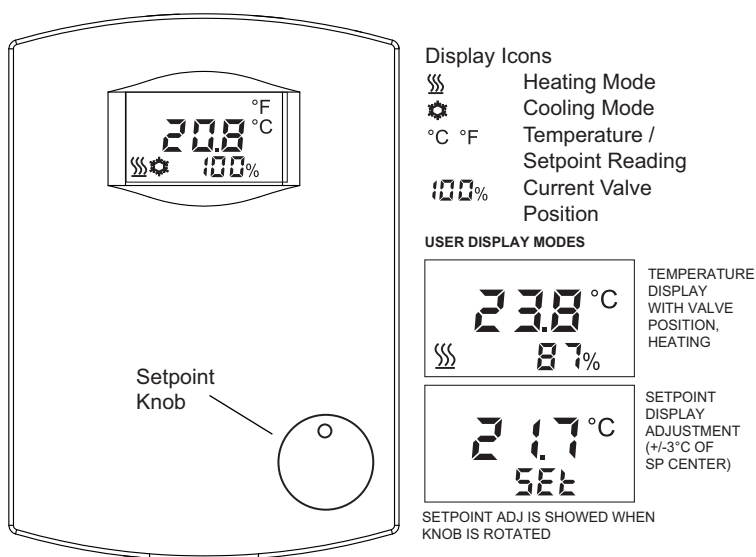

LCD Display (SRC-100-LCD MODEL)

The LCD display shows the controller current operation status to the user.

- Current Temperature
- Current Cooling/Heating Demand
- Heating mode icon when in heating stage
- Cooling mode icon when is cooling stage
- No heating or cooling icon if neither heating or cooling stages are active. Note: With PI control the outputs are usually active within the deadzone.

SRC-100 Control Mode Indication (LEDs)

With SRC-100 model (no display) the LEDs indicate when the controller is in the heating/cooling mode. If the current sensor temperature is less than the lower deadzone limit then the heating LED will be turned on. If the current sensor temperature is greater than the upper deadzone limit then the cooling LED will be turned on. If the current sensor temperature is withing the deadzone limits both LEDs will be turned off.

Controller Configuration

The controller is configured using the push buttons located on the right side of the PCB and the LCD display. Alternatively the controller can be configured via the PC Based Software Configuration Tool.

If the controller model does not have a display, please order the LCD display option for the configuration purposes, if Configuration Tool software is not used.

1. Press either UP or DOWN button and you enter the Parameter Select/Review mode - three character parameter identifier text will flash to indicate this. The display shows the first configuration parameter (setpoint centre) and its current setting.
2. Pressing the UP and DOWN buttons when in the Select/Review mode (three character identifier flashing) will cycle you through the various configuration parameters.
3. If you stay on a parameter for a set length of time you enter parameter change mode and parameter value itself will flash to indicate this (and the backlight changes to amber); pressing the buttons will change its value (flashing will stop). After a timeout if no buttons are pressed the display returns to the

Parameter Select/Review mode, and now the next parameter can be selected using UP and DOWN buttons. Note: If you want to change the same parameter again, select the next parameter and return back to activate change mode.

4. Once the configuration is complete, the controller returns after a few second timeout back to the normal temperature control/display mode.

When the configuration is completed, the display can then be removed if not required.

Precaution. If possible switch off the power before the LCD display is fitted or removed to prevent damage to the electronics.

CONFIGURATION DISPLAY PARAMETERS

<p>PARAM 1: </p> <p>SETPOINT CENTER ADJUSTMENT (RANGE 12 -86 °C/F, DEFAULT: 21°C, 0.1 DEG RESOLUTION)</p>	<p>PARAM 11: </p> <p>ANALOGUE OUTPUT 3 (AO3) SELECTION 0 - Network 1 - None 2 - Heating Stage 1 3 - Heating Stage 2 4 - Cooling Stage 1 5 - Cooling Stage 2 6 - Air-Side 7 - Change-Over</p>	<p>PARAM 21: </p> <p>DIGITAL INPUT OVERRIDE 0 - Night - Off Override (Default) 1 - Cooling Disable 2 - None 3 - Change-Over</p>
<p>PARAM 2: </p> <p>PROPORTIONAL BAND ADJUSTMENT (4°C/F DEFAULT, RANGE 1 to 50)</p>	<p>PARAM 12: </p> <p>THERMIC ACTUATOR OUTPUT 1 (DO1) SELECTION 0 - Network 1 - None 2 - Heating Stage 1 3 - Heating Stage 2 4 - Cooling Stage 1 5 - Cooling Stage 2 6 - Air-Side 7 - Change-Over</p>	<p>PARAM 22: </p> <p>SETPOINT ADJUST LOW (-20 to +0 secs, DEFAUL: -3)</p>
<p>PARAM 3: </p> <p>INTEGRAL ACTION TIME ADJUSTMENT (MINUTES, 600Sec DEF, RANGE: 0-1200 Secs) SET IA = 0 TO HAVE P-CONTROL ONLY</p>	<p>PARAM 13: </p> <p>THERMIC ACTUATOR OUTPUT 2 (DO2) SELECTION 0 - Network 1 - None 2 - Heating Stage 1 3 - Heating Stage 2 4 - Cooling Stage 1 5 - Cooling Stage 2 6 - Air-Side 7 - Change-Over</p>	<p>PARAM 23: </p> <p>SETPOINT ADJUST HIGH (0 to +20 secs, DEFAUL: 3)</p>
<p>PARAM 4: </p> <p>DEADBAND ADJUSTMENT (0.0 to 6.0°C/F, DEFAUL: 1.5°C/F)</p>	<p>PARAM 14: </p> <p>THERMIC ACTUATOR MODE SELECTION 0 = On - Off (0 - 1) 1 - PWM (PLSE)</p>	<p>PARAM 24: </p> <p>LCD BRIGHTNESS (0 to 100%, DEFAUL: 0)</p>
<p>PARAM 5: </p> <p>NO OF HEATING STAGES (0 to 2, DEFAUL: 1)</p>	<p>PARAM 15: </p> <p>3-POINT MODE (DO1 & DO2) SELECTION 0 - Network 1 - None 2 - Heating Stage 1 3 - Heating Stage 2 4 - Cooling Stage 1 5 - Cooling Stage 2 6 - Air-Side 7 - Change-Over</p>	<p>PARAM 25: </p> <p>AntiJAM VALVE EXERCISE PERIOD (0-14 Days, DEFAUL: 0 = OFF)</p>
<p>PARAM 6: </p> <p>HEATING STAGE 1 DIRECTION 0 - Direct (/) 1 - Reverse (l Default)</p>	<p>PARAM 16: </p> <p>3-POINT ACTUATOR RUN TIME (30 to 600 secs, DEFAUL: 150)</p>	<p>PARAM 26: </p> <p>HIGH LIMIT SETPOINT (RANGE 12 -86 °C/F, DEFAUL: 35°C, 0.1 DEG RESOLUTION)</p>
<p>PARAM 7: </p> <p>NO OF COOLING STAGES (0 to 2, DEFAUL: 1)</p>	<p>PARAM 17: </p> <p>3-POINT ACTUATOR RUN ON TIME (0 to 30 secs, DEFAUL: 6)</p>	<p>PARAM 27: </p> <p>LOW LIMIT SETPOINT (RANGE 12 -86 °C/F, DEFAUL: 16°C, 0.1 DEG RESOLUTION)</p>
<p>PARAM 8: </p> <p>COOLING STAGE 1 DIRECTION 0 - Direct (/ Default) 1 - Reverse (l)</p>	<p>PARAM 18: </p> <p>INTERNAL SENSOR OFFSET (-10 to +10 °C/F, DEFAUL: 0)</p>	<p>PARAM 28: </p> <p>LIMIT RATIO (RANGE 0 -5, DEFAUL: 0 = OFF)</p>
<p>PARAM 9: </p> <p>ANALOGUE OUTPUT 1 (AO1) SELECTION 0 - Network 1 - None 2 - Heating Stage 1 3 - Heating Stage 2 4 - Cooling Stage 1 5 - Cooling Stage 2 6 - Air-Side 7 - Chane-Over</p>	<p>PARAM 19: </p> <p>EXTERNAL SENSOR OFFSET (-10 to +10 °C/F, DEFAUL: 0)</p>	<p>PARAM 29: </p> <p>NIGHT MODE OPERATION (rEL = RELAXED SETPOINT, OFF = NIGHT OFF MODE, DEFAUL: rEL)</p>
<p>PARAM 10: </p> <p>ANALOGUE OUTPUT 2 (AO2) SELECTION 0 - Network 1 - None 2 - Heating Stage 1 3 - Heating Stage 2 4 - Cooling Stage 1 5 - Cooling Stage 2 6 - Air-Side 7 - Change-Over</p>	<p>PARAM 20: </p> <p>TEMPERATURE UNIT SELECTION 0 - Celcius (Default) 1 - Fahrenheit</p>	<p>PARAM 30: </p> <p>NIGHT MODE DEADBAND (RANGE 0-40 °C/F, DEFAUL: 6°C, 0.1 DEG RESOLUTION)</p>
		<p>PARAM 31: </p> <p>RELOAD DEFAULTS 0 - --- 1 - Set (Reload Defaults)</p>

Control Loop Operation

The controllers can have up to 2 heating stages and up to 2 cooling stages (as default one heating stage and one cooling stage), and can also carry out automatic change-over from heating to cooling via the digital input.

This allows various control configurations:-

- One/Two Stage Heating Control


- One/Two Stage Cooling Control
- One/Two Stage Heating and One/Two Stage Cooling Control
- One Stage Heating/Cooling Control (Change-Over)

The controller modulates the heating and cooling demand outputs according to the calculated setpoint and the current temperature. The control can be either P-control or PI-control.

As default, heating stage 1 output is linked to Y1 for fully modulating 0..10Vdc control, cooling stage 1 is linked to analogue output Y2 and cooling stage 2 to analogue output Y3.

The controller has also two digital outputs that can be configured to work as PWM or 3-Point control. The PWM or 3-Point control can then be linked to any of the control stages (Heating Stage 1/2 or Cooling Stage 1/2) as required. As default DO1 is linked to PWM control of heating stage 1 and DO2 is linked to the PWM control of cooling stage 1.

Please note that it is possible to set the control loop outputs to direct/reverse, which reverses the control output (valve) running direction (valve drives from 100% to 0%). This can be configured individually for each stage in the Configuration Tool. Via the (configuration) display the Heating Stage 1 and the Cooling Stage 1 operation can also be reversed.

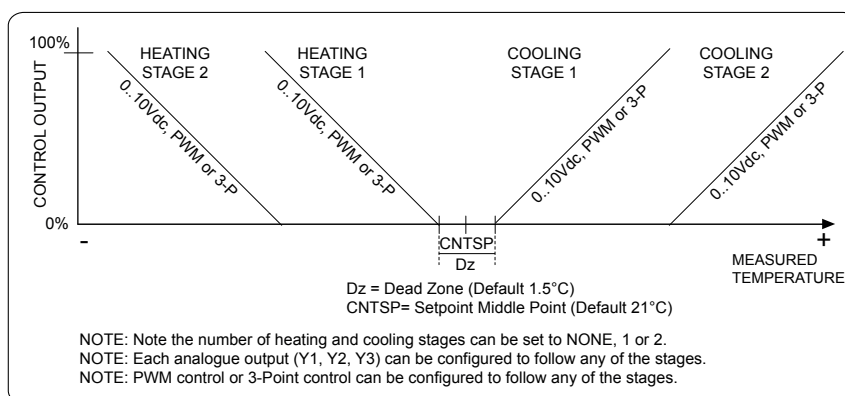

Between heating and cooling stage 1 is a control deadzone. This prevent rapid switching between heating and cooling. The deadzone is adjustable in the configuration parameters.

Night Mode Operation

The controller has two operation modes at night time; Night Off and Night Expanded Deadzone (Relaxed Setpoints). The mode is configured via the display or via the DCT Configuration Tool. The controller can be overridden to Night via

- the Digital Input, if is configured to operate in Night (Off) mode

In the Night Off mode all controller outputs are switched OFF. The LCD displays Night icon and the temperature only.

In the Night Expanded Deadzone mode the controller operates as in the day mode diagram but the Deadzone around the setpoint is expanded to the Relaxed Deadzone setting (as default 6.0°C). The user setpoint adjustment potentiometer is disabled in the expanded Night deadzone mode. The LCD display shows the Night icon and the current temperature.

DZ Mode (PI-Control)

The DZ mode parameter sets the integral action operation (PI-control only) between heating and cooling stages when the temperature is within the deadzone. As default the mode is set to HOLD where the integral term is held inside the deadzone. This reduces plant wear and tear. By setting the parameter to MODULATE, the integral term modulates to zero within the deadzone if the temperature remains within the deadzone. The closes the heating and cooling outputs.

High/Low Limit Control (Reset Control)


If an external NTC10 sensor is fitted and the Setpoint Adjust Limit Ratio has been set (>0) then the controller can carry out high limit and/or low limit control. In high limit control, if the external temperature exceeds the High Limit setpoint, the main control setpoint is reduced by the amount set in the Limit Ratio. E.g. if the Limit Ratio is 2, every degree that the external temperature exceeds the High Limit setpoint, the main setpoint is reset by 2 degrees.

The Low Limit control works in reverse. If the external temperature drops below the Low Limit setpoint, the main control setpoint is increased by the amount of the ratio for every degree below the Low Limit setpoint.

The current calculated setpoint is available via the DCT configuration tool.

Air-Side Control Logic

Air-side control is implemented by combining the Heating Stage1 and Cooling Stage 1 demands. As such to use air-side the number of heating stages must be set to 1 or more and the number of cooling stages must be set to 1 or more. In normal operation the stage direction for heating stage 1 and cooling stage 1 should be set the same.

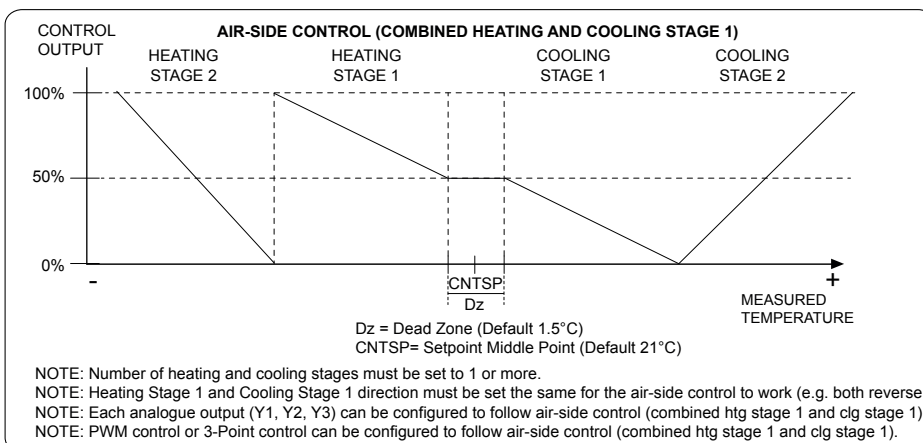

Note: The effective proportional band of the Air-side control is twice that of the Heating2 and Cooling2 stages due to the fact there is only one proportional band setting for all stages.

Digital Output (Triac) Operating Modes

The digital outputs (24Vac Triacs that switch 24Vac to 0V) can operate as 3-point control for heating, as PWM control (pulse width modulation control) or as On/Off control. The type of the control is selected via the configuration parameters. If the 3-point actuator mode is selected, the controller modulates the DO1 on when valve is required to be opened and DO2 when the valve is required to be closed. The 3-point operation can be configured to follow any of the stages. It is also possible to reverse the output operation by reversing the corresponding loop output.

When the 3-point output is driven fully open or closed, the output is driven against the edge for a "run on" period (default 6 seconds) and this will be repeated every 10 minutes. The run on time time adjustable via the configuration parameters and this behaviour can be disabled completely by setting the run on time to 0.

If PWM actuator is used the duty cycle is 30 seconds as default (configurable via the tool). E.g. if the output is at 50% then the output is ON for 15 seconds and OFF for 15 seconds.

If the PWM mode has been set to On/Off, then the corresponding digital output is switched ON at the Max Level (default 100%) and are switched OFF at the Min level (default 0%).

Digital Input Modes; Cooling Disable / Night Mode / Heating-Cooling Change-Over

If the Digital Input has been configured as Cooling Disable, by closing the digital input contact (volt-free), the cooling modes are disabled and the cooling stage outputs are set to 0%.

If the Digital Input has been configured as Night mode, by closing the input contact, all outputs are disabled in the Night Off mode, and in the Expanded Deadzone mode the Deadzone is expanded to the Night Deadzone setting.

If the Digital Input is set to Change-Over, when the input is open the Heating Stage 1 is active, if the digital input is closed e.g. by an external thermostat, the Cooling Stage 1 is active. To activate this mode on the outputs, select Change-Over option for the DO1, DO2 or 3-Point Modes.

AntiJAM Valve Exercise Function


If the AntiJAM function is enabled the controller monitors for inactivity. If the control outputs have been fully closed or fully open more than the AntiJAM period, the controller will open/close the outputs to by 30% (or ON/OFF in case of ON-OFF mode) for a short period of time. The AntiJAM function is enabled through the configuration parameters or via the DCT configuration tool by selecting the required AntiJAM period by days.

External Sensor Input

The controller uses as default the internal temperature sensor. If an external NTC10 temperature sensor is connected to the input RI1, and a valid sensor reading is measured, the controller starts automatically to use the external temperature sensor for the control.

Software Configuration Tool


The parameter options can also be configured using the Software Configuration Tool in addition to the configuration via the LCD and buttons. If the Configuration software is used, this is connected via the PC USB cable to the programming header of the transmitter as shown on the image below.

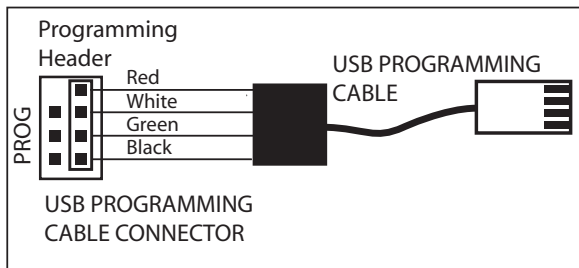

The correct process for connecting the controller via the USB is as follows:-

- Disconnect USB Connector from PC
- Disconnect the Controller from Power
- Plug-In the 4-Way Connector to the Sensor
- Connect the USB to the PC
- Power Up the Controller

NOTE: Always disconnect USB from PC before plugging the cable into the controller.

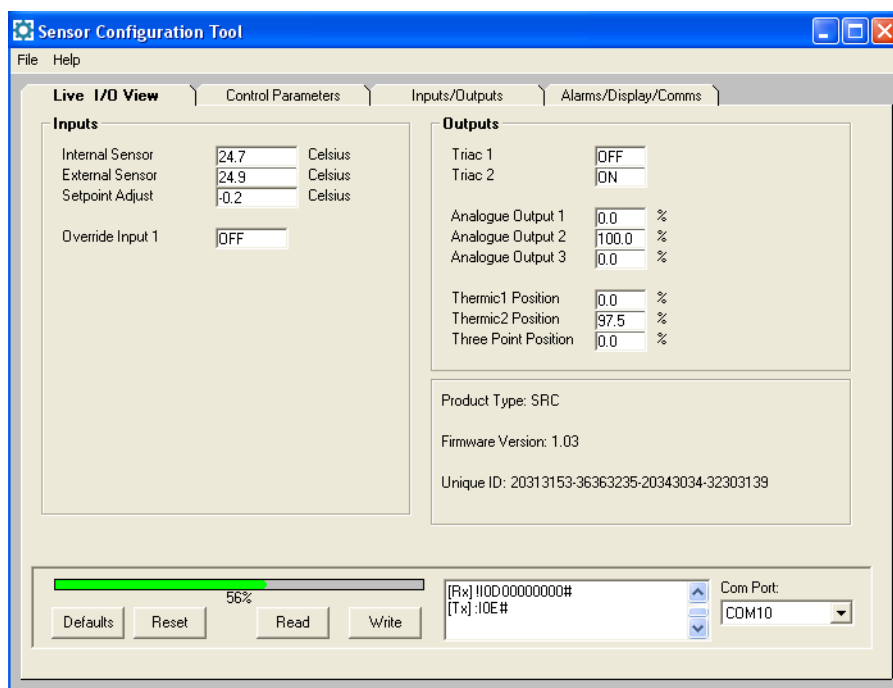

Common Parameters	
Parameter Name	Description
Defaults	Reloads the default configuration from the sensor non-volatile memory. Note: All modified settings are lost.
Reset	Performs soft reset of the controller. Apply after major changes.
Read	Reads the controller data.
Write	Writes the new settings to the controller (automatically stored in the non-volatile memory)
COM Port	Select the COM port for the USB Cable or Bluetooth. USB cable driver must be installed in order the Serial to TTL connection to operate.

Live IO-View		
Parameter Name	Description	Range
INPUTS		
Internal Sensor	Internal Temperature Sensor Reading	0..50°C (32..122°F)

Live IO-View		
Parameter Name	Description	Range
External Sensor	External Temperature Sensor Reading (RI1)	0..50°C (32..122°F)
Setpoint Adjust	Current Setpoint Adjustment	-20..+20°C/°F
Override Input 1	Digital Input Status	Off - On
OUTPUTS		
Triac 1	Digital Output 1	Off - On
Triac 2	Digital Output 2	Off - On
Analogue Output 1	Analogue Output 1	0..100%
Analogue Output 2	Analogue Output 2	0..100%
Analogue Output 3	Analogue Output 3	0..100%
Thermic1 Position	Thermic Output 1 Position	0..100%
Thermic2 Position	Thermic Output 2 Position	0..100%
Three Point Position	Three Point Output Position	0..100%
CONTROL		
Calculated Setpoint	Current Calculated Setpoint	12..86°C/°F
Heating Demand	Current Heating Demand	0..100%
Cooling Demand	Current Cooling Demand	0..100%

Control Parameters		
Parameter Name	Description	Range
Setpoint	Setpoint Middle Position.	12..86°C/°F (Default 21.0°C)
Setpoint Adjust Max	Temperature Setpoint Maximum Adjustment	0.0...20°C/°F (Default 3.0)
Setpoint Adjust Min	Temperature Setpoint Minimum Adjustment	-20.0...0°C/°F (Default -3.0)
Proportional Band	Proportional Ban	1.0..50.0 °C/°F (Default 4.0)
Integral Action Time	Integral Action time of the control loop. Set to 0 to disable.	0..1,200 seconds (Default 600s)
Deadzone	Deadzone Between Heating and Cooling Stages	0.0..6.0°C/°F (Default 1.5°C)
Heating Stages	Number of Heating Stages	0 = None 1 = 1-Stage (Default) 2 = 2-Stages
Heating Stage 1 Direction	Heating Stage 1 Direction	0 = Reverse (Default) 1 = Direct
Heating Stage 2 Direction	Heating Stage 2 Direction	0 = Reverse (Default) 1 = Direct
Cooling Stages	Number of Cooling Stages	0 = None 1 = 1-Stage (Default) 2 = 2-Stages
Cooling Stage 1 Direction	Cooling Stage 1 Direction	0 = Reverse 1 = Direct (Default)
Cooling Stage 2 Direction	Cooling Stage 2 Direction	0 = Reverse 1 = Direct (Default)
Night Mode	On/Off or Expanded Deadzone Night Mode Selection	0 = Expanded Deadzone 1 = On/Off (Default)
Night Deadzone	Deadzone Between Heating and Cooling Stages in the Night Mode	0.0..40.0°C/°F (Default 6.0°C)
DZ Mode	Integral Action Operation in Deadzone	0 = Hold (Default) 1 = Modulate
RESET CONTROL (HIGH AND/OR LOW LIMIT CONTROL)		
Enable	Enable Reset Control	Disabled/Enabled
High Limit Setpoint	High Limit Setpoint	12..86°C/°F (Default 35.0°C)
Low Limit Setpoint	Low Limit Setpoint	12..86°C/°F (Default 16.0°C)
Limit Ratio	Low/High Limit Ratio	0-5 (0=Disabled, Default)

Inputs / Outputs		
Parameter Name	Description	Range
INPUTS		
Internal Sensor Offset	One Point Internal Temperature Calibration Field	-10.0..+10.0°C/°K (Default 0°C)

Inputs / Outputs		
Parameter Name	Description	Range
External Sensor Offset	One Point External Temperature Calibration Field	-10.0..+10.0°C/K (Default 0°C)
DI1 Function	Digital Input 1 Function	0 = Override Night (Default) 1 = Disable Cooling 2 = None 3 = Change-Over
OUTPUT ASSIGNMENTS		
AO1 (Y1)	Analogue Output Y1 Mode	0 = Network Value 1 = None 2 = Heating Stage 1 (Default) 3 = Heating Stage 2 4 = Cooling Stage 1 5 = Cooling Stage 2 6 = Air-Side 7 = Change-Over
AO2 (Y2)	Analogue Output Y2 Mode	0 = Network Value 1 = None 2 = Heating Stage 1 (Default) 3 = Heating Stage 2 4 = Cooling Stage 1 5 = Cooling Stage 2 6 = Air-Side 7 = Change-Over
AO3 (Y3)	Analogue Output Y3 Mode	0 = Network Value 1 = None 2 = Heating Stage 1 3 = Heating Stage 2 4 = Cooling Stage 1 5 = Cooling Stage 2 (Default) 6 = Air-Side 7 = Change-Over
Thermic 1	Thermic Output 1 Mode (Linked to DO1)	0 = Network Value 1 = None 2 = Heating Stage 1 (Default) 3 = Heating Stage 2 4 = Cooling Stage 1 5 = Cooling Stage 2 6 = Air-Side 7 = Change-Over
Thermic 2	Thermic Output 2 Mode (Linked to DO2)	0 = Network Value 1 = None 2 = Heating Stage 1 3 = Heating Stage 2 4 = Cooling Stage 1 (Default) 5 = Cooling Stage 2 6 = Air-Side 7 = Change-Over
3-Point	Three Point Output Mode (Linked to DO1 & DO2) NOTE: If selected Thermic 1 and Thermic 2 are automatically set to None.	0 = Network Value 1 = None (Default) 2 = Heating Stage 1 3 = Heating Stage 2 4 = Cooling Stage 1 5 = Cooling Stage 2 6 = Air-Side 7 = Change-Over
DO1	Digital Output 1 Mode. Set to Control to activate control logic.	0 = Network 1 = Control (Default)
DO2	Digital Output 2 Mode. Set to Control to activate control logic.	0 = Network 1 = Control (Default)
THERMIC ACTUATORS		
Mode	Thermic Actuator Mode	0 = PWM (Pulse Width Modulation, Default) 1 = On/Off
Min. Level	Minimum Output Level (Switch Off Level)	0..100% (Default 0)
Max. Level	Maximum Output Level (Switch On Output)	0..100% (Default 100)
PWM Period	Pulse Width Modulation Period	0..255 seconds (Default 30)
3-POINT ACTUATOR		

Inputs / Outputs		
Parameter Name	Description	Range
Stroke Time	3-Point Actuator Running Time	30..600 seconds (Default 150)
Run On Time	3-Point Actuator Run On Time when Fully Open /Closed	0..30 seconds (Default 6)
VALVE EXERCISE (AntiJAM)		
Anti-Jam Timeout	Valve Exercise Monitoring Period.	0 = Disabled (Default) 1-14 days

Alarm/Display/Comms		
Parameter Name	Description	Range
DISPLAY		
Temperature Units	Temperature Unit Selection	0 = Celsius (Default) 1 = Fahrenheit
LCD brightness	Brightness of the LCD	Off - 10% to 100% (Default Off)
COMMS- NOT APPLICABLE		

Parameter Storage The configuration parameters are stored in the non-volatile memory. When the changes are carried out via the configuration display or via the Configuration Tool, the parameters are stored in the non-volatile memory when the controller returns to a normal display mode.

Dimensions

